


SDD 09H04 2 Circuit Service Meter Breaker Pedestal and Breaker Disconnect Box

GENERAL NOTES

MINIMUM REQUIREMENT SHOWN. ADDITIONAL BREAKERS MAY BE REQUIRED.
UP TO THREE BREAKERS WILL BE CONSIDERED INCIDENTAL TO THE ITEM
BREAKER DISCONNECT BOX.

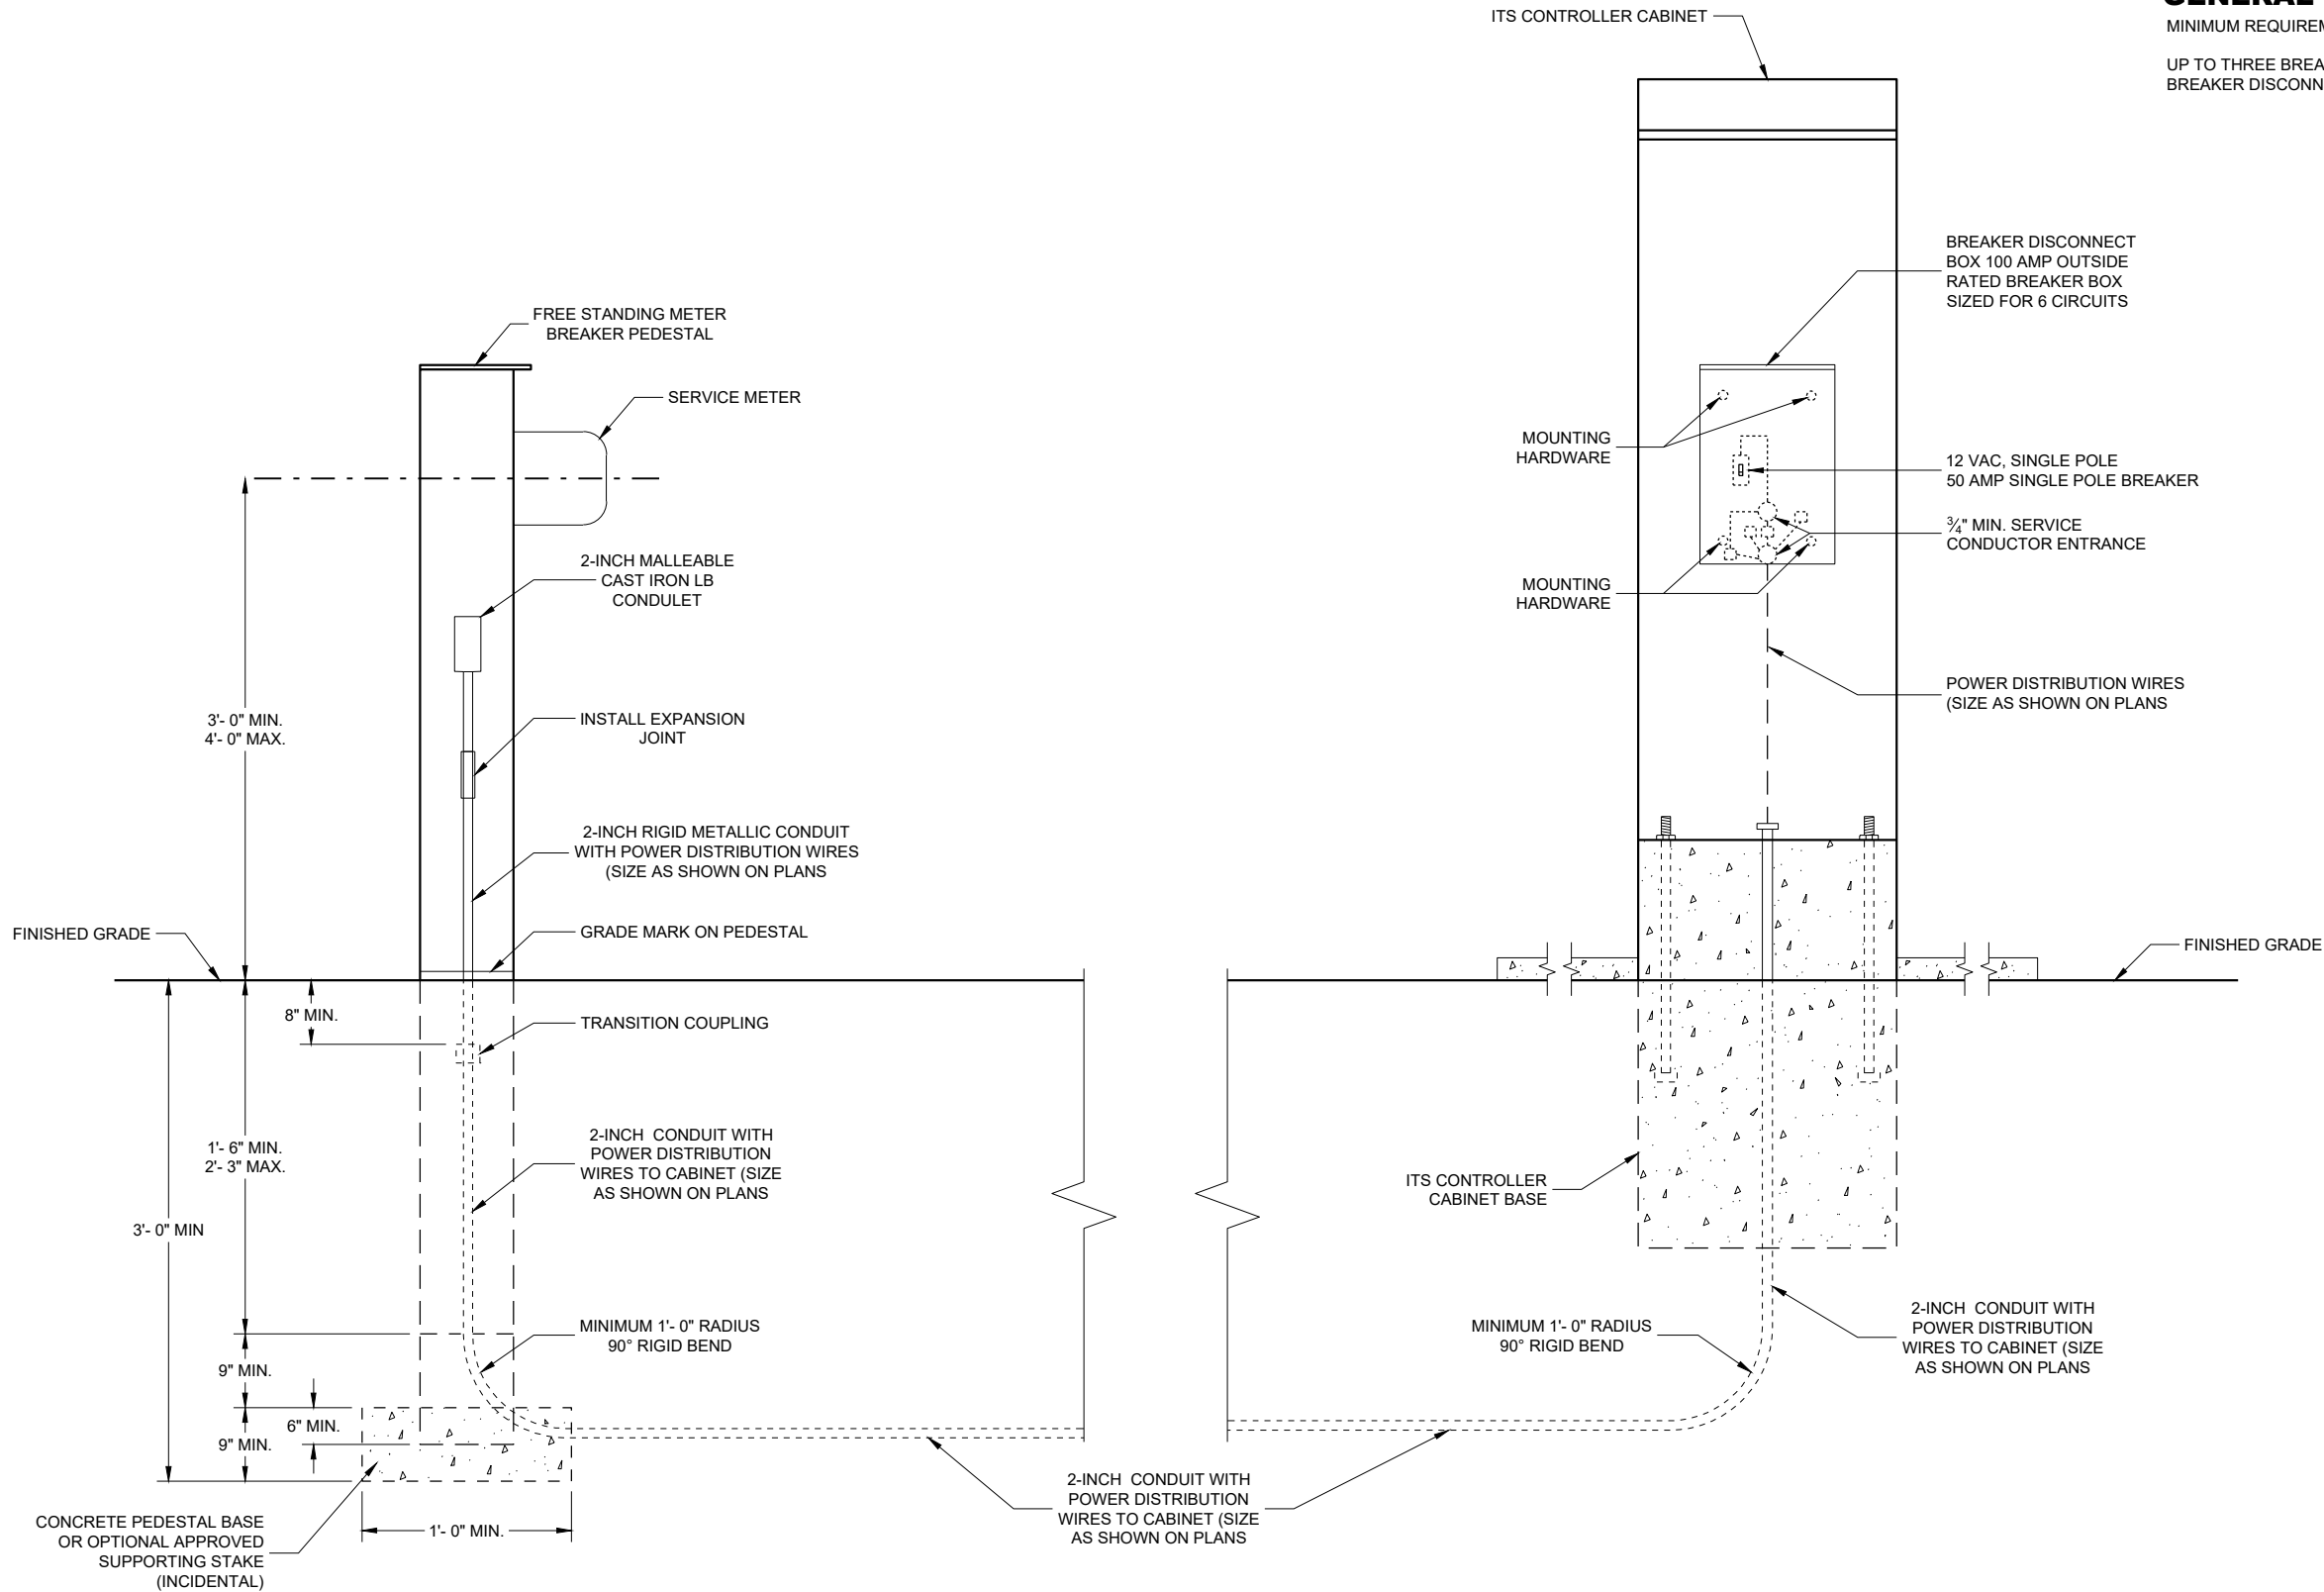

**2 CIRCUIT ELECTRICAL SERVICE METER BREAKER
PEDESTAL AND BREAKER DISCONNECT BOX**

2 CIRCUIT ELECTRICAL SERVICE METER BREAKER PEDESTAL AND BREAKER DISCONNECT BOX

STATE OF WISCONSIN
DEPARTMENT OF TRANSPORTATION

APPROVED
September 2014 /S/ Ahmet Demirbilek
DATE STATE ELECTRICAL ENGINEER

FHWA

2 Circuit Electrical Service Meter Breaker Pedestal and Breaker Disconnect Box**References:**

[FDM15-5 Attachment 30.5](#) and [30.6](#) for conventional symbols

[Standard Spec. 656](#) Electrical Service

[Standard Spec. 670](#) General Requirements for Intelligent Transportation Systems

Bid items associated with this drawing:

<u>ITEM NUMBER</u>	<u>DESCRIPTION</u>	<u>UNIT</u>
656.0201	Electrical Service Meter Breaker Pedestal (location).....	EACH

Standardized Special Provisions associated with this drawing:

<u>STSP NUMBER</u>	<u>TITLE</u>
NONE	

Other SDDs associated with this drawing:

SDD 9B2	Conduit
SDD 9H1	Base ITS Controller Cabinet

Design Notes:

NONE`

Contact Person:

Ahmet Demirbilek (414) 220-6801
(414) 322-9606 (Mobile)